

SOLUTIONS FOR AUTOMATION OF CRITICAL ENGINEERING INFRASTRUCTURE



DEVELOPMENT OF SYSTEM SOLUTIONS AND PLATFORMS. 20 YEARS & MORE



CONTENTS

- 1. Development of system platforms and solutions
- 2. Model solutions automation of electric networks for ROSSETI PJSC
- 3. Model solutions automation of the urban environment
- 4. Model solutions automation of enterprises
- 5. Information security
- 6. Automation of electric energy storage
- 7. Automation as service of IoT operator
- 8. Technology business partners
- 9. Contact details




MACRO TRENDS FOR ENERGY MANAGEMENT BY 2040



3

- The planet's population will increase by 2 billion and exceed 9 billion people. To ensure the safety of such a number of energy technologies, all energy sectors will undergo a transformation and transition to new technological structures - Industry 4.0.
- Reducing the energy intensity of GDP of all countries will lead to competition in the field of energy.
- The working-age population in Europe will decrease by 8%.
- Coal will continue to be the dominant form of energy production (38% of output), but environmental concerns will lead to a rethink of wise energy use and lead to government regulations.
- After 2035, the sale of vehicles with internal combustion engines will be banned in the European Union..

Peaks of coal consumption by country at 1970-2040

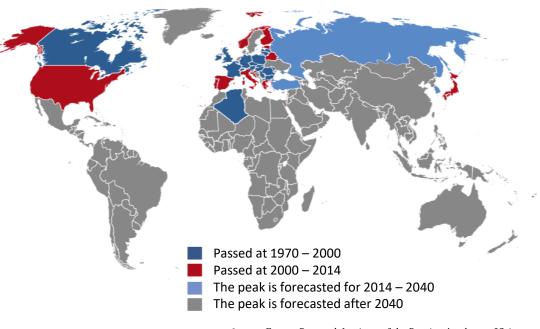

Source: Energy Research Institute of the Russian Academy of Sciences





DEVELOPMENT OF SYSTEM PLATFORMS AND SOLUTIONS

ENTELS Engineering Center specializes in providing a full range of services for the development and implementation of commercial and technical energy metering systems, telemechanics, dispatch and automated process control systems in housing and communal services distribution networks and large enterprises.

KEY PRODUCTS OF ENTELS

Digital platform ENTEK

■ **SOFTWARE** → SCADA-system ENTEK, SoftLogic ENLOGIC platform and additional software extension modules

SCADA-system ENTEK

Universal software product for creating of automated control systems, telemechanics, automated process control systems, energy metering, energy monitoring, dispatching and other tasks in the energy sector.

SoftLogic ENLOGIC platform

Communication solutions based on controllers of the EnLogic software platform for creating protocol converters, telemetry and SCADA systems, monitoring systems for digital relay protection systems, etc.

■ **EQUIPMENT** → controllers, servers and complete cabinets for energy metering and control, various measuring sensors, metering devices, special equipment (relay protection terminals, short circuit identifier modules, etc.)

Model solutions

- Comprehensive automation of distribution network facilities
- Automation of power supply to an industrial enterprise
- Automation of transformer substations
- Integrated dispatch and automation of boiler houses
- Automation of electricity storage media and charging stations for electric vehicles, etc.

DEVELOPMENT OF SOFTWARE AND HARDWARE SYSTEMS

The system of software and hardware complexes of Entels LLC is built on the basis of smart metering devices, sensors and various actuators that provide automated online control of the distribution and consumption of resources. Information from metering devices is transmitted to the upper level, to the data collection server. The system is built on the SCADA platform and has a hierarchical structure consisting of three levels.



Lower level (periphery)

primary meters (smart meters), sensors, actuators and peripherals



Intermediate level (data collection)

multifunctional controllers (can be virtual) that accumulate information from metering devices and transmit it to the upper level



Upper level (servers and software)

monitoring and control servers and digital workstations provide solutions to the tasks of the energy dispatcher, planning department, analyst, chief power engineer, technologist, and enterprise director



1

Eliminating the human factor as a source of abnormal and emergency situations and increasing safety



theft

2

Minimizing energy consumption

by switching to more favorable

tariffs and identifying leaks,

malfunctioning equipment, and

3

Analysis of telemetric data and creation of specialist work profiles (digital assistant)



Reduce operating costs by automating operating cost control



5

Remote diagnostics of equipment condition



Improved production planning taking into account energy consumption opportunities



Monitoring the work of personnel and equipment in optimal schedules and modes



Reliable information, online, about the progress of the technological process, the condition of equipment and technological controls



Retrospective information for analysis, optimization and planning of equipment operation for its repair and maintenance



10

Cost reduction due to automated control of energy consumption and detection of violations of technological discipline and theft

LICENSES, DIPLOMAS AND CERTIFICATES



The company independently develops all software products, has licenses, certificates and other documents confirming ownership for all developments











SCADA system ENTEK No. 2020615565 dated May 18, 2020

SoftLogic platform "EnLogic" software No. 2009614875 dated 09/08/2009

Services for the implementation of automation systems, development, production and supply of automation cabinets Certificate of conformity to ISO 14001-2016

Services for the implementation of automation systems, development, production and supply of automation cabinets Certificate of conformity to ISO 9001-2015


Licenses of the Federal Service for Technical and Export Control for "Activities for the development and production of means of protecting confidential information" and for "Activities for the technical protection of confidential information"





MODEL SOLUTIONS

AUTOMATION OF ELECTRIC NETWORKS FOR ROSSETI PJSC

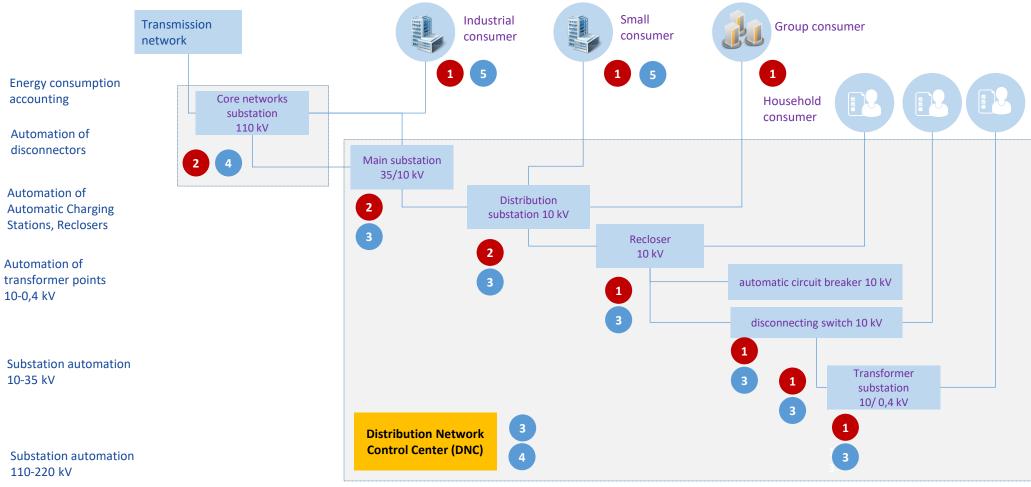

- Substation automation 110-220 kV

accounting

Automation of disconnectors

Automation of

Automation of

10-0,4 kV


10-35 kV

- Controller and modules for automation of transformer substation, recloser, disconnector
- **Automation Controller at Distribution Transformer** Substation 10 kV & substations on 35 / 110 / 220 kV
- Central transceiver station for collecting data from power grid objects
- SCADA system for automated process control systems of substations

SCADA for enterprise automation


AUTOMATION OF OBJECTS BASED ON THE ENTEK CONTROLLER



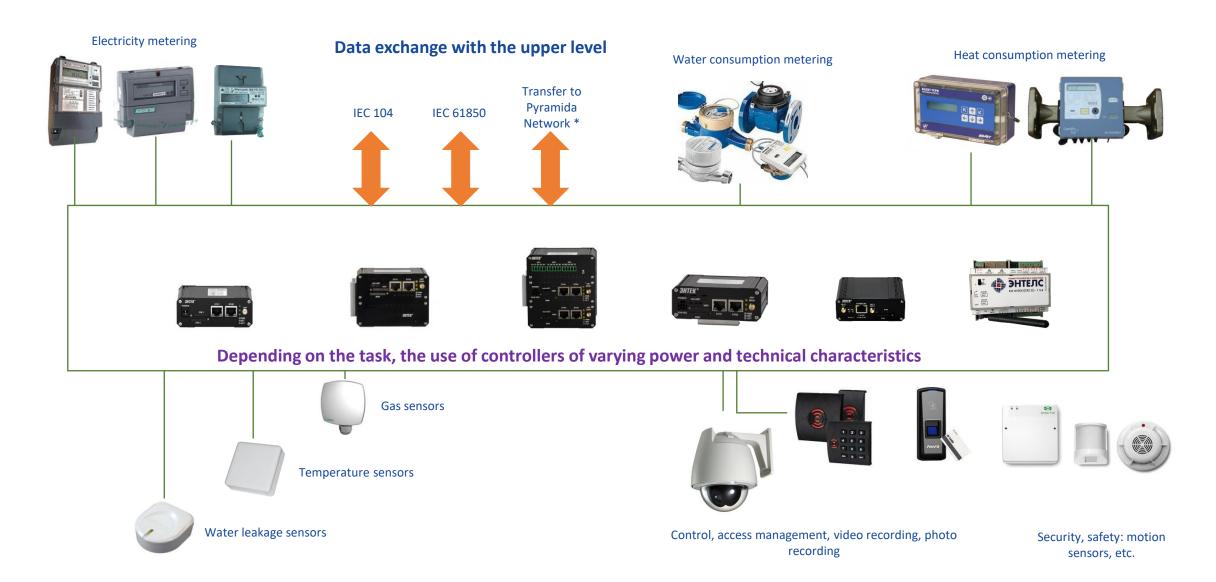

AUTOMATION FOR NETWORK COMPANIES

Transformer substation

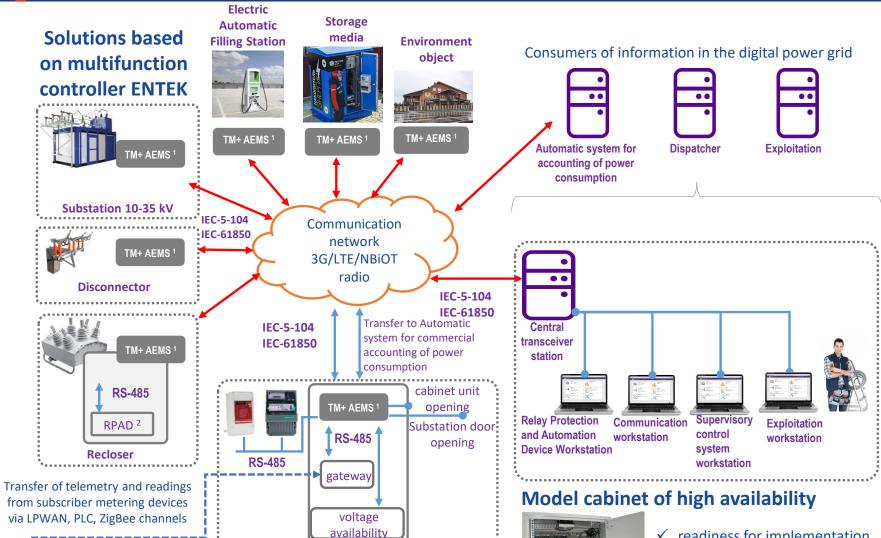

AT MORE THAN 50 000 AUTOMATION **FACILITIES OF ROSSETI COMPANY**

SOLUTIONS HAVE BEEN IMPLEMENTED

- Supply of power quality controllers and monitoring of measuring instruments
- · Implementation of a unified distribution network management system for 20 branches
- Supply of a unified network distributor management system
- Implementation of a unified network distributor management system





- ✓ readiness for implementation
- fast delivery time
- ✓ ready to use





MODEL SOLUTIONS

AUTOMATION OF PUBLIC ENERGY INFRASTRUCTURE AND URBAN ENVIRONMENT

IMPLEMENTATION EXAMPLE – AUTOMATION OF A GYMNASIUM **ENTELS**





Transfer of information about power supply modes and emergencies to resource companies

Electricity distribution network


- ✓ control of unauthorized opening of the electricity meter
- ✓ electricity consumption
- √ no voltage

Heat distribution network

- √ flowing pressure
- √ temperature deviation
- √ heat consumption

Water and wastewater treatment plant

- ✓ pressure
- ✓ water consumption

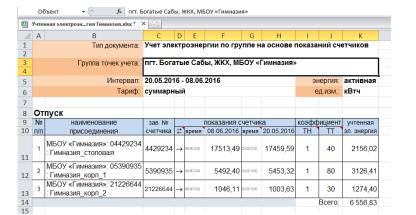





Sending SMS in cases:

- occurrence of accidents
- deviations of energy consumption from planned

Notifying the dispatcher in cases:

- fire, flooding, deviation from normal conditions
- access to equipment and metering devices

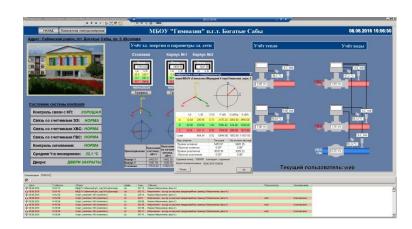

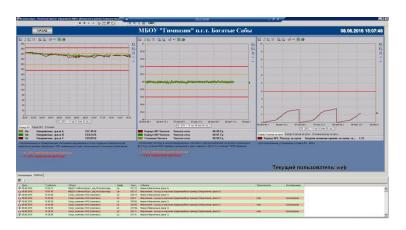

IMPLEMENTATION EXAMPLE - KINDERGARTEN AUTOMATION







Displaying the state of the object on GIS, online. Monitoring communications, accidents and energy efficiency of the kindergarten

Transfer of information about energy supply modes and accidents to resource supply companies according to the protocol IEC-104 Electricity distribution network

- ✓ control of unauthorized opening of the electricity meter
- ✓ electricity consumption
- ✓ no voltage

Heat distribution network

- ✓ flowing pressure
- ✓ temperature deviation
- ✓ heat consumption

Water and wastewater treatment plant

- ✓ pressure
- √ water consumption




Sending SMS in cases:

- occurrence of accidents
- deviations of energy consumption from planned

Notifying the dispatcher in cases:

- fire, flooding, deviation from normal conditions
- access to equipment and metering devices

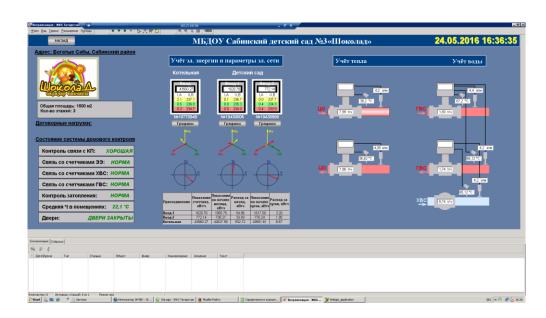



IMPLEMENTATION EXAMPLE – SPORTS COMPLEX AUTOMATION ENTELS



Transfer of information about power supply modes and emergencies to resource companies

Electricity distribution network

- ✓ control of unauthorized opening of the electricity meter
- ✓ electricity consumption
- √ no voltage

Heat distribution network

- √ flowing pressure
- √ temperature deviation
- √ heat consumption

Water and wastewater treatment plant

- ✓ pressure
- ✓ water consumption




Sending SMS in cases:


- occurrence of accidents
- deviations of energy consumption from planned


Notifying the dispatcher in cases:


- fire, flooding, deviation from normal conditions
- access to equipment and metering devices




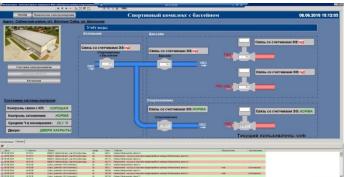

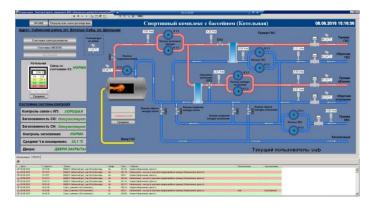

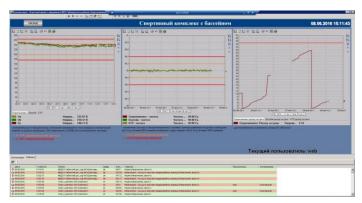

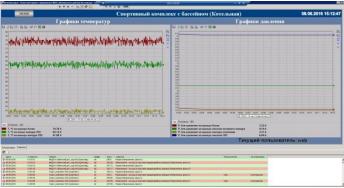


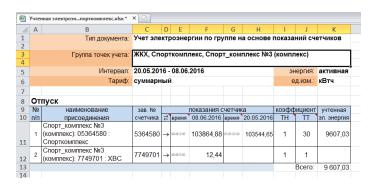


LIGHTING WITH DIMMING AND ZONE SCENARIOS



Lighting for urban infrastructure of parks, gas stations, industrial areas, railway platforms. Ability to work with LED lamps - work with plans and schedules, built-in additional features and functions.

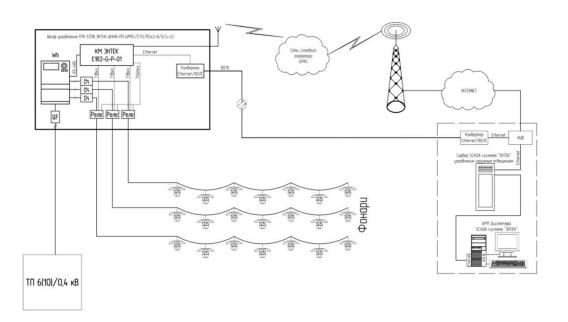


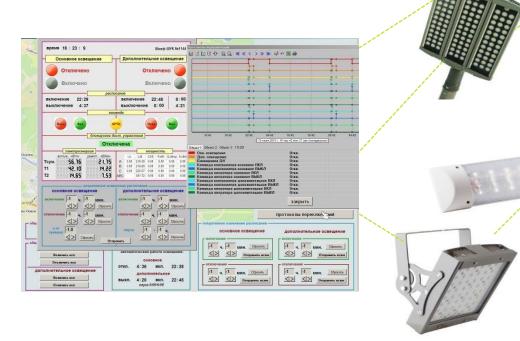


Monitoring the energy efficiency of equipment operation

Объект	Направление	Текущий режим работы	Текущее состояние	Ручное управление	Автоматическое управленние текущая команда	Автоматическое управленние следующая команда	Текущая мощность	Расчетная уставка по мощн. текущая	Расчетная уставка по мощн. полная	Ua, B	Ub, B	Uc, B	Контроль ламп
Симулятор	Линия №1	Ручной		ф	К1 Откл 17.09.2014 6:27:00	К1 Вкл 17.09.2014 20:28:00	17.0 кВт	18.5 кВт	18.5 кВт	220	220	218	Отчет
Симулятор	Линия №2	Включ	Включена	中	К2 Откл	К2 Вкл	6.3 кВт	7.0 кВт	7.0 кВт	220	216	216	Отчет
ТП-1	Линия №1	Ручной ▼	Включена	-	К1 Откл 17.09.2014 6:27:00	К1 Вкл 17.09.2014 20:28:00	18.3* кВт	18.5 кВт	18.5 кВт	-	1	-	Отчет
111-7	Линия №2	Тучной	Отключена	=	К2 Откл	К2 Вкл	6.8* кВт	7.0 кВт	7.0 кВт	-	-	-	Отчет
ТП-2	Линия №1	Ручной ▼	Включена	1	К1 Откл 17.09.2014 6:27:00	К1 Вкл 17.09.2014 20:28:00	18.3* кВт	18.5 кВт	18.5 кВт	-	-	-	Отчет
111-2	Линия №1	Гучной 🔻	Отключена	-	К2 Откл	К2 Вкл	6.8* кВт	7.0 кВт	7.0 кВт	-	i	-	Отчет

LIGHTING FOR ENTERPRISES

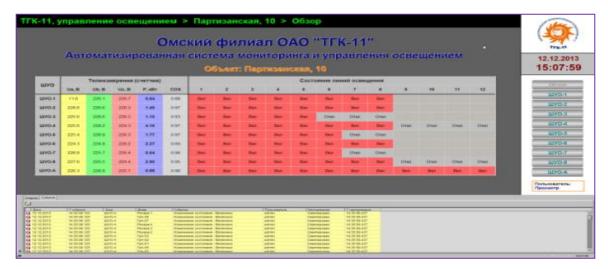

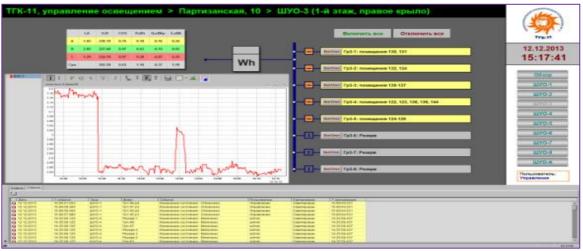


Automated lighting control system of city of Omsk stations -TSK11



Tasks

- ✓ continuous monitoring of parameters and condition of lighting line equipment, prompt detection of damage
- ✓ remote and automatic, scheduled, control of lighting modes
- ✓ automated multi-tariff metering of consumed electricity
- ✓ identification of losses and ineffective operating modes

MANAGEMENT OF WATER UTILITY FACILITIES

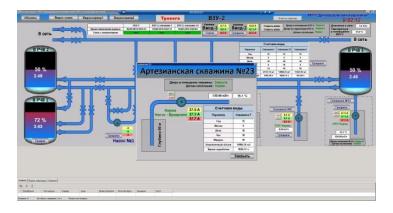




HADAN BAUROCOPRESS (MARCHER PRESS) BRACE CENTRAL BAUROCOPPESS (MARCHER PRESS) BRACE CENTRAL BAUROCOPPESS (MARCHER PRESS) DESCRIPTION OF BAUROCOPPESS (MAR


Domodedovo water utility




- ✓ Continuous monitoring of equipment parameters and condition, prompt detection of damage
- ✓ Remote and automatic mode control
- ✓ Automated multi-tariff metering of electricity and water
- ✓ Access control and video recording
- ✓ Identification of losses and ineffective operating modes

HEATING NETWORK FACILITIES MANAGEMENT

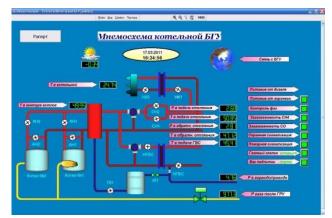

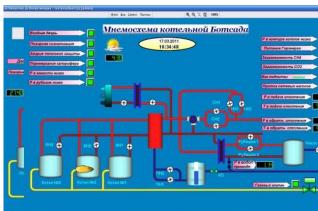

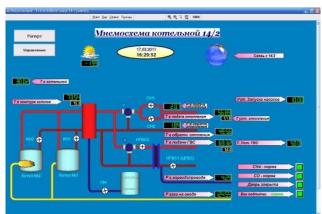




Heat supply of city of Yakutsk




- Continuous monitoring of equipment parameters and condition, prompt detection of damage
- Remote and automatic mode control
- Automated multi-tariff metering of electricity and water
- Access control and video recording
- Identification of losses and ineffective operating modes

COMPREHENSIVE NETWORK MANAGEMENT BY LOCAL GRID COMPANY



			-		leretra.	- Hasen	35	Canada Assessed	area ACTA		
 Tipodirena. 						Mageens'	Hoseronasee	man'			
	Others	Others, respective in		300	Ten	Aapmi	Tom weeks	Tell (s.	Hastpoleur &DOM	Hac tyer	
	TOTAL STREET	COLUMN	76	01163	1400	Considerance t	Elements.	Managam 200 ART 40 CN	Нескорой 230 на	Dameson Howcones	
Office On	TO US History	MARKAGE OUTSTANDARD	72	(900.26)	. 1	net 26 Commons	Etnombi.	Menogen ZID ART (DICLN	Meta-sport 200, no.	Banacal Horropos	
	TO 125 Horrows	strangers.	71.	00000	111	Constitutional no. 1	Kanasana	Hespitan 230 ART (DICLN	Majorquet 200, no.	Dameun How year	
	TEL STREET PROPERTY.	MARKET AND ADDRESS TO A	7%	00021	1	Consideration 1	Economics.	Managen 230 ART-03 CLN	Management 2000, ma.	Damasan How open	
	113-135 toperappy	SOURCE ADVENUE OF THE	75	00021	1	Conscionants 1	Edwards	Mesoupen 200 ART-00 CLN	Macagnet 200 as	Barnesser Honropou	
		MANUAL OCCUPANTAL	72	00041	1	vet 26 Convices	Kanaga	Manager 230 nRT 03 CLN	Manageri 220 as	Denema How open	
	TO 125 Houseway	commence	76	01003	4	Construence to 1	Kanasage	Manager 200 ART 00 CLN	Managemen 200 au	Deneses How oppos	
	TIS-125 Hoperappa	Figures di E-2		01157	- 3	Copulocas nos	Tecontr.	NZIRART-CIPRILIDN	Macropole 200 na	Benezel Horropos	
	TTI-125 Hourspan	Concentral		01157	2	Consideration	Tecner	N230 ART GIPRS IDN	Micropol 230 or	Demous How oppos	
	TOT-144 Properties	тоговый меня Ти		01160	2	Pagement or	Exercises.	NZ3SART-00 PQRS IDN	Herryane 220, es	Dames at How spice	
	773-144 Incercopas	PRINCIPLOS COMPANIONS	4 12	01787	. #	\$4000000000	Кончест	M230 6RT-03 PC KIN	Mecogoni 230 ns	Benevio Horropos	
	TTI-144 Inversors	Indexes	- 00	00990	0	Passporentes.	Exemp.	H230.6RT2400	Moreomet 200, sa	Dameson Horropos	
	TIT-144 Houseman	mere	- 66	02119	0	Proposition.	Eastern	Hermann 230 ART-00 PRIL	Herespeet 220, no.	Democratition speci	
	TTI-144 Hineropox	MARKET	252	00211	-1	Фарропологи	Конмира	Messagen 230 ART-OPPRI	Management 2000, ma.	Benezin Horropos	
	TIT-165 Hiseroppa	cellent	72.	02034	2.1	un Parto-son ti	Farmers.	Meanuren 200.02		Damesel How open	
4	TO 185 Hourons	ranceines "Agropares	4. 75.	00991	- 1	yn Partonee 6	Eponomers.	Hermann 200.04	House, good PLC, ea.	Dameson How your	
Taxatine.	373-145 Hoeropaa	orrowed final and no	254	00900	100	un Pathy un fi	Equipment.	Messagen 200 ART-00 CLN	Mackagneli (200 mt.)	Banapar Horropos	
F W Negargasi 300	TIS 145 Hoperopoly	ormones fone	254	007900	. 1	un Parlonne 6	Kinnesspe.	Mesongen 230 ART-00 CLN	Magazgodi 200; sa.	Dameson Honropos	
W Happan 230	TO-165 Houseman	oreman face	294	00000	. 1	un Patherson G	Kansoner.	Henryson 230 ART 60 CLN	Managest 220, se-	Denieum How cook	
L. A. LEICH	TTI-145 Hoseropous	rapine serofinies	15	00900	. 0	yn Padorae 6	Konnept.	Meanigen 230 ART-03 CLN	Mepognei 200, ns.	Banacai Horropos	
	TITLES Hoperators	crommas WTE	196	00/90	1	se Paterse 6	Keenige	Heorigen 230 ART 40 CLH	Majorgeon 200, no.	Democratition open	
Г ₩ Симирования	T/3-145 Houseman	Copyrigate Care	120	00490	-1	gar 2 in Consum 2	Kanadaire	Heuropean 230 nRT-03 CLN	Major agend 200, sa.	Determent House spring	
	TO-185 Incercense	Famous 1-2		00000	9	ye Patty and B	Tecour	Mesospen 230 ART-00 CLN	Magazgost 210, no.	Benevill Horropos	
□ ¥ pywini odop	TIT-185 Hoeropox	France in Tri		00500	3	ge Pationer 6	Teamer	Metergree 230 ART-00 CLN	Mapagest 220, sa.	Bankosi Hosropos	
IT ST ART	TIT-152 Hourspeak	monagem	45.	01776	2.0	yn Nupeneum 10	Hannings.	Heorigen 230 ART 02 CLN	Majorquist PLC, na.	Democrat How spice	
100	TTI-150 Prographs	базовал станция ск	329	01703	. 2	suffapezean 11	Esterator.	Heorigen 230 ART-02 PRISIS	Magazgiori 200, as	Benezal Horropos	
	T/1-16 Hoserstone	уживое осоещивая	72	00095	4	pebli Donce canno	Kiewspe	Heprigren 200 ART-00 CLN	Mapagenti PLC, no.	Danasan Homopos	
	TES-10 Hosensons	nonmouses fir 45 M (. 400	00049	0	Duramontonian.	Estemps	Hapergram 230 ART-01 CLN	Hope speed PLC, ask	Demonstration spon	
	TTS-TE Prograpping	commence Nº 48	400	01750.	. 0	Витослевлицая.	Finnespe	Herogen 230 ART-01 CDI	Historiani PLC: no.	Banacai Houropos	
	4)										





Municipal power grids of city of Veliky Novgorod



A unified distribution network management system, including city and regional branches. Implemented using client-server architecture.


More than 400 city substations

More than 30,000 electricity meters


Tasks


- ✓ Dispatcher control of the electrical network
- ✓ Electric power control for consumers with limitation modes
- ✓ Technical and commercial electricity metering

ELECTROCHEMICAL PROTECTION MANAGEMENT

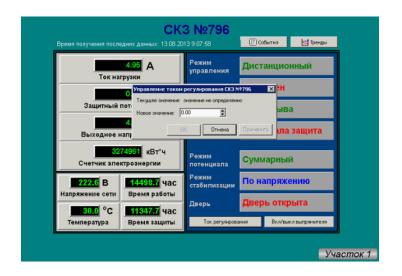



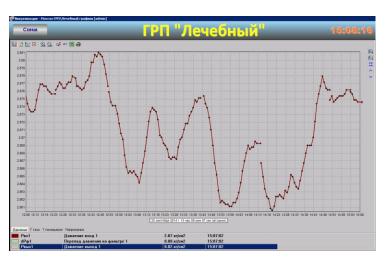

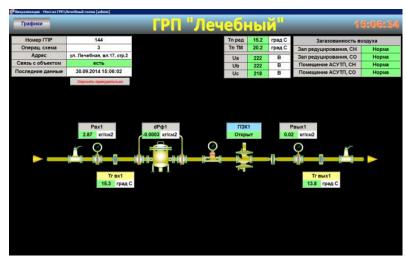

Electrochemical protection control system «MOSGAZ»

- ✓ There are more than 5000 objects in the system;
- ✓ The system provides continuous monitoring of equipment parameters and condition, prompt detection of damage;
- ✓ Remote and automatic mode control;
- / Emergency control;
- ✓ Identification of losses and ineffective operating modes.




Joint products for automation of electrochemical protection of pipelines with ENERGOMERA corporate group




СТАВРОПОЛЬСКИЙ РАДИОЗАВОД СИГНАЛ

Integration with electrochemical protection equipment of the SIGNAL plant

MANAGEMENT OF GAS FILLING STATIONS

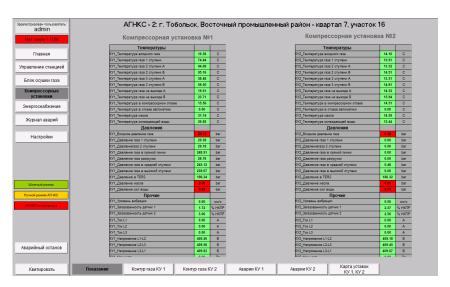

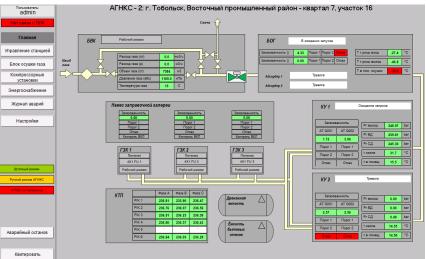

COMPLEX "ATLANT"

Application in automobile gas filling compressor stations of "Natural-gas-based motor fuel of Gazprom" for station automation






MODEL SOLUTIONS


AUTOMATION OF INDUSTRIAL ENTERPRISES AND PRODUCTION SITES


AUTOMATED DISPATCH CONTROL SYSTEM



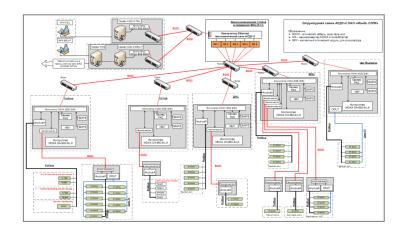



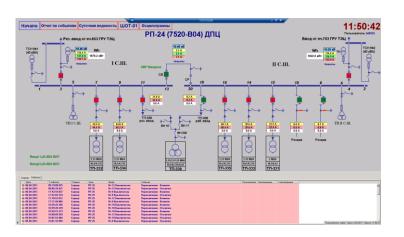

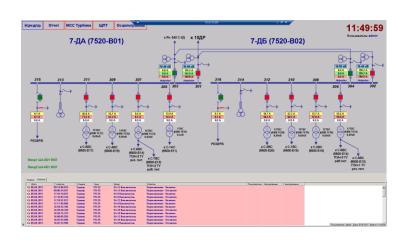

Management of the Syktyvkar timber industry complex "MONDI"



- continuous monitoring of equipment parameters and condition, prompt detection of damage
- remote and automatic control of operating modes
- monitoring of emergency modes, subtraction of oscillograms of the digital relay protection system
- ✓ identification of losses and ineffective operating modes

AUTOMATED PRODUCTION MANAGEMENT SYSTEM




Tasks solved by the system

- ✓ Online operational control of resource consumption (electricity, water, gas);
- ✓ Supervisory control of the state of energy supply to an enterprise with adaptive consumption control;
- ✓ Comparison of planned resource consumption with actual consumption across production lines with warning signals in case of deviation from the reference consumption of a resource;
- ✓ Commercial and technical accounting of resources and reporting to a resource-supplying organization;
- Dispatch control with establishing a single dispatch panel to manage energy supply to an enterprise.

Results


- ✓ Reducing energy costs, as part of production costs, by up to 5% depending on the consumption plan;
- ✓ Planning resource costs depending on production load plans;
- Reducing accident rates and equipment downtime is achieved through operational monitoring of the equipment condition and modes of its use;
- ✓ Possibility to increase production volumes by planning and creating a reference equipment load;
- ✓ Creating reference planning for resource consumption depending on the production plan;
- ✓ Operational control of deviations from reference consumption;
- ✓ Identification of non-productive energy costs.

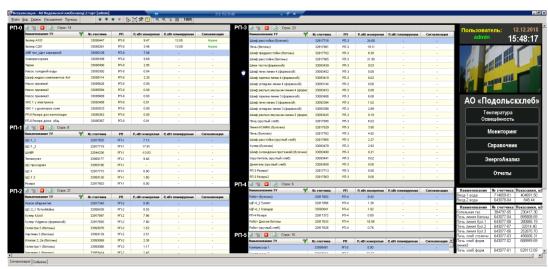


Mnemonic diagram of production load dynamics, provides information online



Report on the cost of production



Alarm in case of deviation from the norm



Temperature and light monitoring, used to calculate energy consumption costs




Creating reference consumption

Operation of the energy monitoring system


Detection of deviations from reference energy consumption

- SMS
- Notification to the energy engineer in the following cases:
- occurrence of accidents
- deviations of energy consumption from the planned (reference)

- ✓ Planning the energy consumption of an industrial enterprise based on production plans will help identify and eliminate sources of resource loss
- ✓ Special tools make it possible to identify deviations from normal energy supply. These tools are built into the SCADA-system ENTEK to implement operational management tasks and control the consumption of resources.
- ✓ The user can receive information via SMS, Email or an alarm signal on the control panel mnemonic diagram.

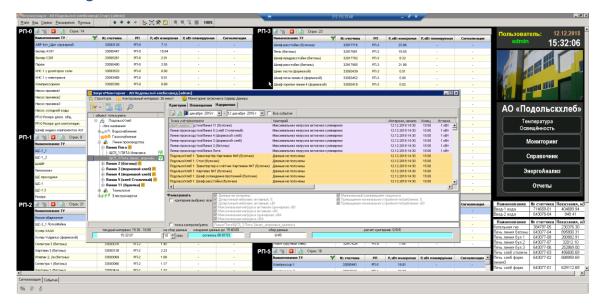

Monitoring of energy consumption with assessment of the main factors of deviation from the normal mode of energy supply

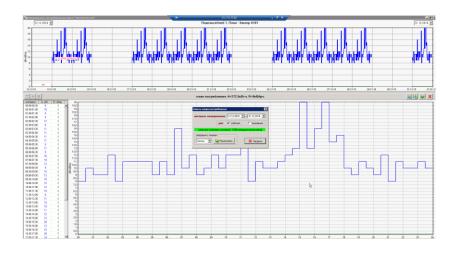

Forming of a reference consumption plan to control the balance of electricity






INFORMATION SECURITY

Ensuring information protection for information control systems

INFORMATION SECURITY

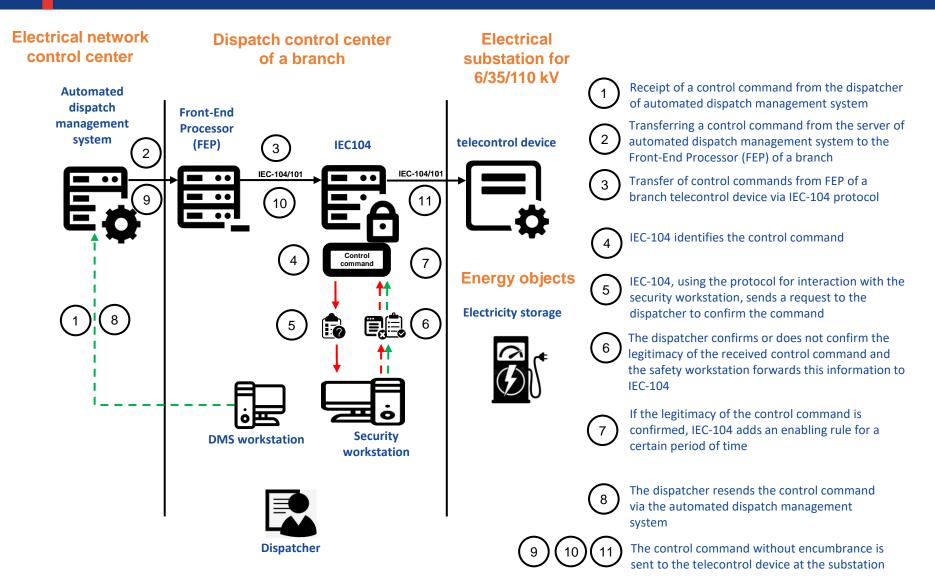

The implementation is carried out jointly with the companies "AVATEK" and "Infotex" at "ROSSETI MR" PJSC



Joint developments in the field of information security in energy networks and facilities



Joint developments in the field of information security




Joint developments in the field of automation of power networks, which are to be implemented in branches of ROSSETI MR

unit, generator, telecom operator infrastructure facility, electric charging station, electricity storage device, etc.

Data Acquisition and Transmission Device "ENTEK" with overlaid encryption means - a joint development of "ENTELS" LLC and "InfoTeKS" OJSC intended for building secure local and distributed systems for automatic control and management of technological processes of small automation objects via public communication channels to protect them from computer attacks and unauthorized access to information.

Telemechanics system for dispatch control and resource record

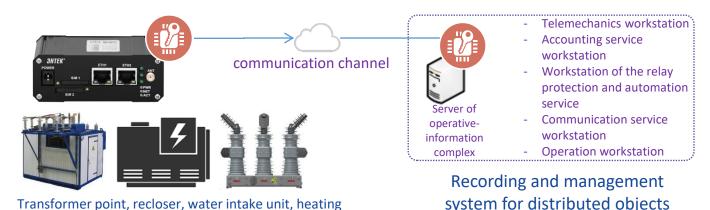

Possibilities

For objects of the Substation type, a standard software and hardware complex based on ready-made equipment is used. This allows to create a single information-protected network for all types of objects with minimal costs

Conclusion on the compatibility of the E2R2 (G) controllers with VipNet information security software systems







NEW SOLUTIONS

Automation of electric energy storage



Secure technological data transmission network based on public networks of mobile telecom operators using commercial metering protocols DLMS/COSEM telemechanics IEC-5-104, IEC-61850

Unified automated process control system - Unified electrical network control center







Network manager

Service desk

......

Unified regulations

Storage media Manufacturer 1



Storage media Manufacturer 2



Storage media Manufacturer N Communication network 3G/LTE/NBiOT radiocommunication


Electronic storage devices - workplace of competence center for development of storage media at Management Company "RUSNANO"



IEC-5-104

IEC-61850


DLMS/COSEM





Messenger for managing the operation of storage devices

Server and workstations for monitoring the operation of storage media – generation of analytical data on operability, efficiency, accident rate

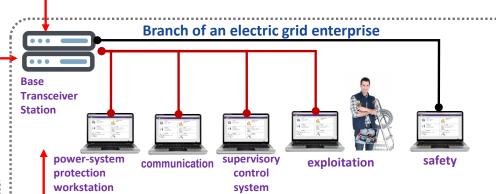

Engineering workplaces for electric grid enterprise specialists



A single gateway for the transmission of telemetry information, statistics, information for operation management, ensures the collection of data from all branches, the transfer of information on equipment performance statistics, the transfer of information to external systems, consumers



Contractors

^{*} Protocol IEC101/104. Where IEC101 is acronym for IEC 60870-5-101, which is a standard for power system monitoring, control & associated communications for telecontrol, teleprotection, and associated telecommunications for electric power systems. And IEC104 is acronym for IEC 60870-5-104 protocol, which is an analogy to IEC 60870-5-101 protocol with the changes in transport, network, link & physical layer services to suit the complete network access: TCP/IP.

ELECTRICITY STORAGE MEDIAS MANAGEMENT



CENTRALIZED CONTROL OF STORAGE MEDIA WORK

The inclusion of storage medias into centralized monitoring ensures the inclusion and monitoring of all storage medias as part of a single automated dispatch management system network based on a unified set of telemetry data.



CONTROL OF THE STATE OF STORAGE MEDIA AS PART OF THE POWER NETWORK

A centralized collection of information has been organized to monitor and analyze the status and operation of storage media with output of information to the development center of storage media to evaluate the effectiveness of their use and the generation of "big data" analytical data on the operation of storage media from different manufacturers and technologies.



CONDITION MANAGEMENT OF STORAGE MEDIA THROUGH THE ENTIRE LIFE CYCLE


Remote maintenance, setting up monitoring scenarios and monitoring the operation of storage media throughout the entire life cycle of storage media operation from a single center of competence.



INCREASING INFORMATION SECURITY

The use of the solution allows to implement data protection when using public communication networks and blocking unauthorized control commands, which ensures information protection of the control system for electrical grid infrastructure facilities

ELECTRICITY STORAGE MEDIAS MANAGEMENT

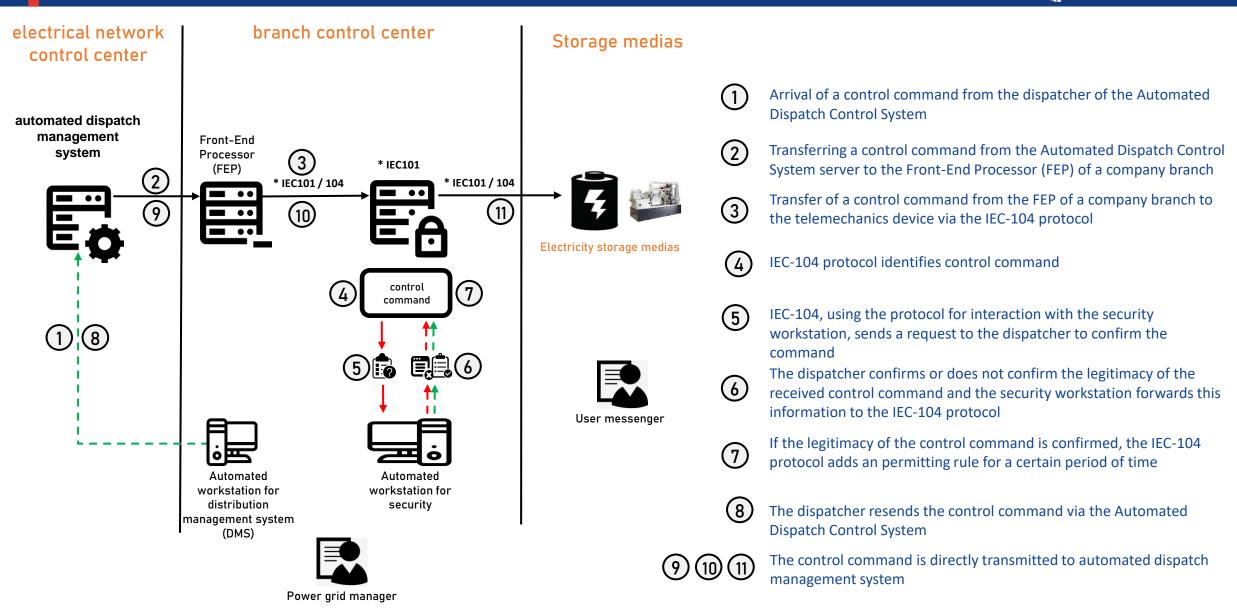


^{*} Protocol IEC101/104. Where IEC101 is acronym for IEC 60870-5-101, which is a standard for power system monitoring, control & associated communications for telecontrol, teleprotection, and associated telecommunications for electric power systems. And IEC104 is acronym for IEC 60870-5-104 protocol, which is an analogy to IEC 60870-5-101 protocol with the changes in transport, network, link & physical layer services to suit the complete network access: TCP/IP.



MESSENGER FOR WORK CONTROL

- A mobile application of the "Field Service Management Software (FSM)" class is a part of and one of the modules of the Central Receiver/Transmitter "ENTEK" software. It provides interaction on all issues of storage media operation.
- Users install the software on a tablet or smartphone.
 When performing work and exploitation, they receive the necessary information and register the work. The software includes automatic identification of equipment by QR codes, RFID and NFC tags.
- The messenger simplifies the monitoring and exploitation of storage media. The software works in off-line mode. The mode allows to use the software without a communication channel at the site.
- The software is built into the Central Receiver/Transmitter "ENTEK". It allows to create a unified business process for managing electrical distribution network facilities.

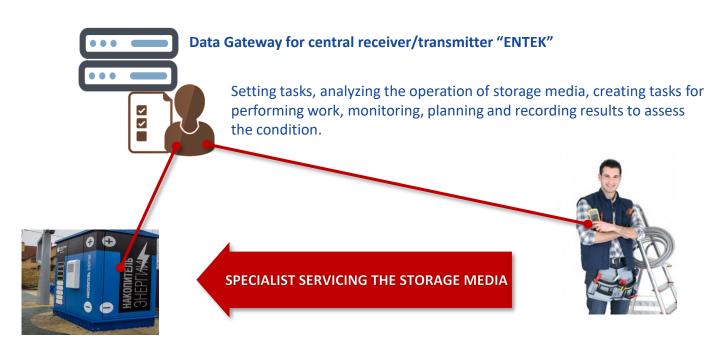














INPLEMENTATION FOR NETWORK CONTROL CENTERS


A standard solution (Hardware-Software Complex) has been developed for storage media automation, ensuring the collection of technological data on a single server from 20 regions.

The solution was implemented as a unified control and management system in 20 branches of ROSSETI Center PJSC , ROSSETI Center and Volga Region as part of the Unified Network Management Center.


A local server has been developed for Group of Companies RUSNANO for centralized monitoring of storage media from all manufacturers in real time with automatic generation of statistics and efficiency diagnostics.

Reports for managers on the current state of equipment, deviations in the operation of storage devices, as well as operating parameters and parameters of electricity, supplied to the network, are generated automatically.

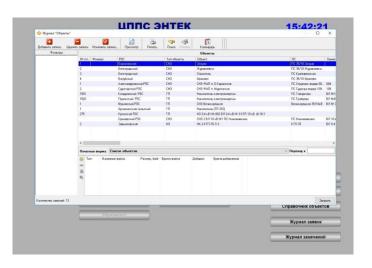

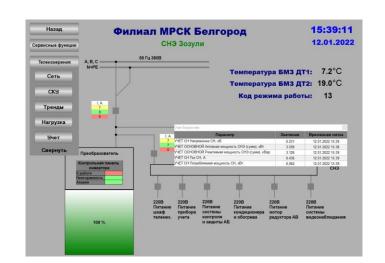



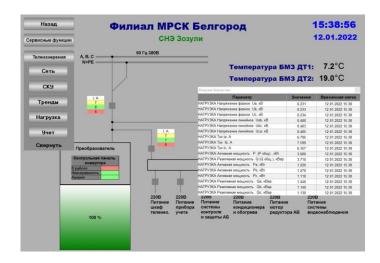





NEW SOLUTIONS Automation as service of IoT operator




The potential demand is at the domestic energy and infrastructure markets. Such objects include infrastructure facilities.

- Territorial electric distribution companies;
- Water and wastewater treatment plants, heating suppliers, lighting;
- Social infrastructure educational institutions, hospitals, administrative buildings;
- Energy facilities of industrial enterprises.

Software and hardware system allow to implement telecontrol systems, metering systems, Computer-Aided Process Control System for facilities of the electric grid company and utility infrastructure. Using of normal and cyber-protected mode allows to apply solutions for critically important objects: power grids, water utilities, infrastructure facilities, etc.

TECHNICAL SUPPORT INCORPORATED IN SERVICES OF OPERATOR



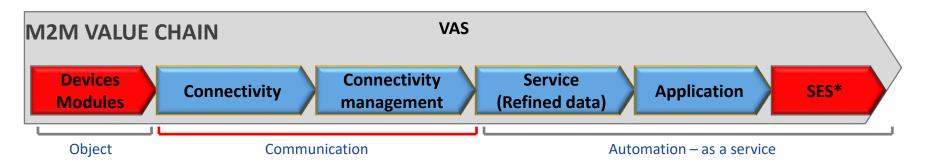

The role of the integrator

- installation of equipment at facilities in accordance with standard technical solutions;
- use of ready-made standard technical solutions;
- equipment maintenance;
- setting up solutions for private technical tasks (improving solutions)

This approach allows the customer to:

- receive automation in conformity with the planned result;
- get guaranteed technical support;
- shorten the implementation period;
- simplify exploitation and further development;
- · minimize investments in infrastructure and personnel;
- · have the opportunity for continuous development.

Advantages

- You can work with the systems from anywhere in the world.
- · Outstanding reliability.
- Possibility to combine remote offices and branches in one place.
- There is no need to purchase expensive licensed software.
- There is no need for outsourcing of information technology and programmers.
- There is no degradation and obsolescence of the equipment, it is supplied as part of the service.
- It is possible to transfer all data from your server in office, to a remote server or backward.
- 24/7 technical support.
- Development and updating of software at all stages of the life cycle.
- The performer is responsible for the final result of the work.

^{*} Service Enablement Services (IT politics management, service activation/deactivation)









































ЭНЕРГОМЕРА





TELEOFIS°


















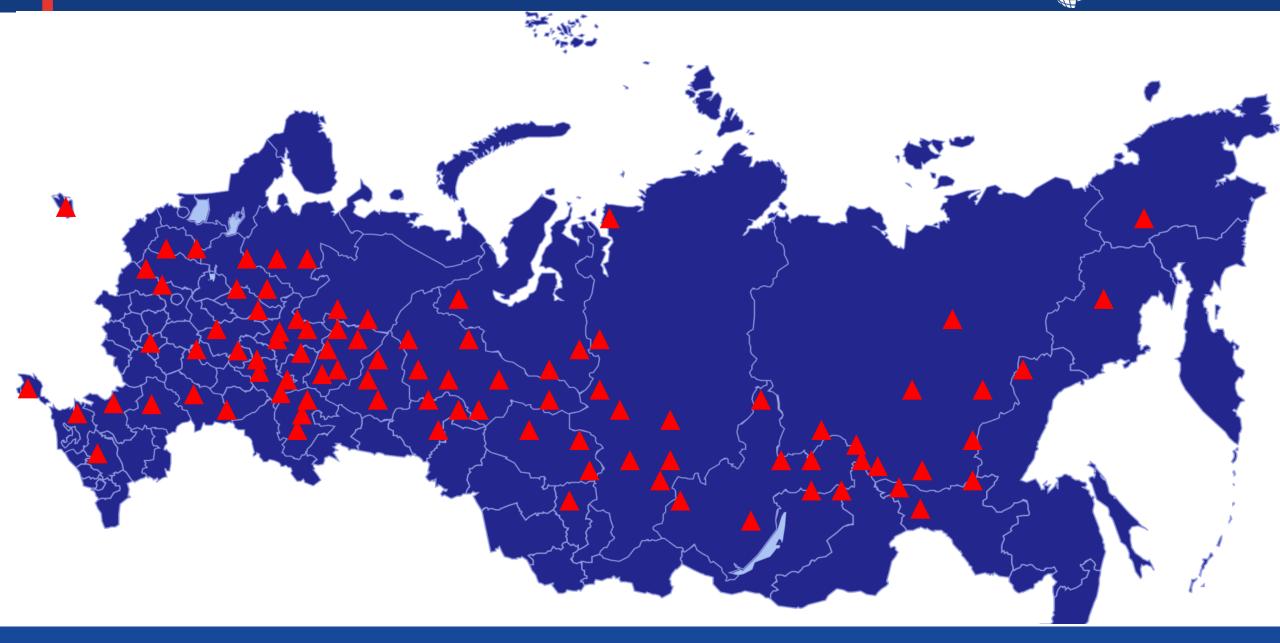



CONTACT DETAILS





+7 (499) 110-31-79



info@entels.ru



108811, Moscow, Rumyantsevo subway station, Business Park "Rumyantsevo", building B, 5th entrance, 6th floor, office 608



Technical support service https://support.entels.ru/



www.entels.ru

